

SFI-CAB-CW-2
Date: _____

CHILLED WATER CASED COIL

TAG: _____




PH (800) 430-2536
FAX (800) 718-3738
www.SFICOILS.com

CONSTRUCTION:


- 1) CASING: 16 GA, GALV.; 1" THICK, 1.5# SF INSULATION
 - INDOOR STD OUTDOOR WEATHERPROOFED
 - SINGLE WALL DOUBLE WALL
- 2) DRAIN PAN; 1" COUPLING DRAIN CONNECTION
 - 16 GA, GALV. 16 GA, STAINLESS
- 3) SPECIAL ITEMS
 - _____
 - _____
 - _____

FOR APPROVAL
 FOR RECORD

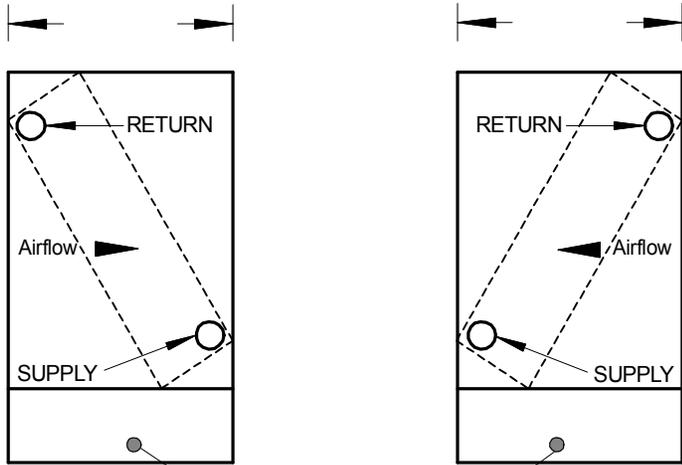

RIGHT HAND COIL LEFT HAND COIL

SIDE ELEVATION VIEW

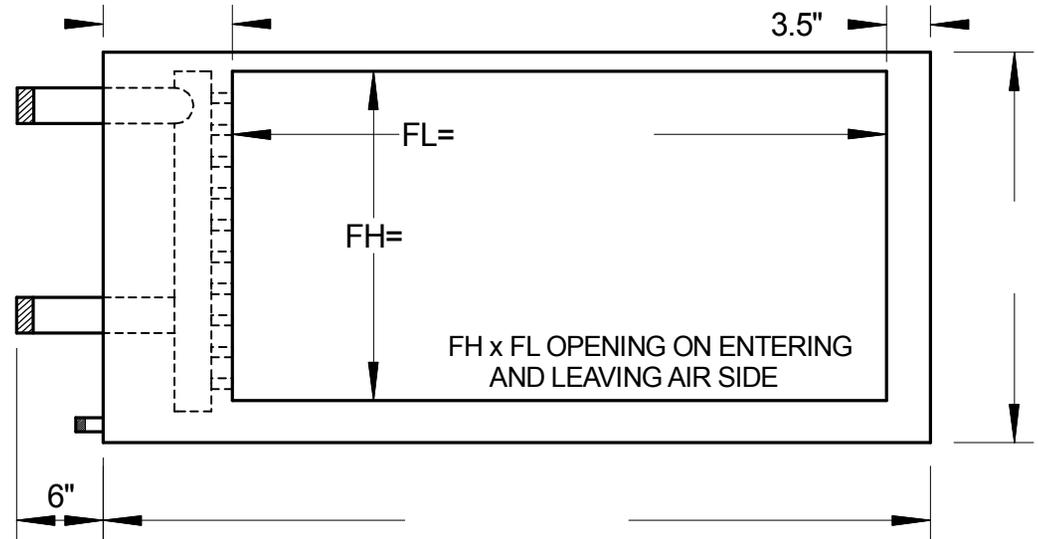

ENTERING / LEAVING AIR SIDE ELEVATION VIEW

TUBES _____ ROWS _____
FIN TYPE _____ FINS/INCH _____
CIRCUITING _____

CONNECTIONS

- COPPER STEEL OTHER
- MPT MPT SPECIFY
- FPT PLAIN END
- ODS

SUPPLY SIZE: _____ RETURN SIZE: _____

NOTES:

SFI-CAB-DX-1

Date: _____

DIRECT EXPANSION CASED COIL

TAG: _____



PH (800) 430-2536

FAX (800) 718-3738

www.SFICOILS.com

CONSTRUCTION:

1) CASING: 16 GA, GALV.; 1" THICK, 1.5# SF INSULATION

INDOOR STD OUTDOOR WEATHERPROOFED

SINGLE WALL DOUBLE WALL



2) DRAIN PAN; 1" COUPLING DRAIN CONNECTION

16 GA, GALV. 16 GA, STAINLESS

3) SPECIAL ITEMS


- _____
- _____
- _____

- FOR APPROVAL
- FOR RECORD

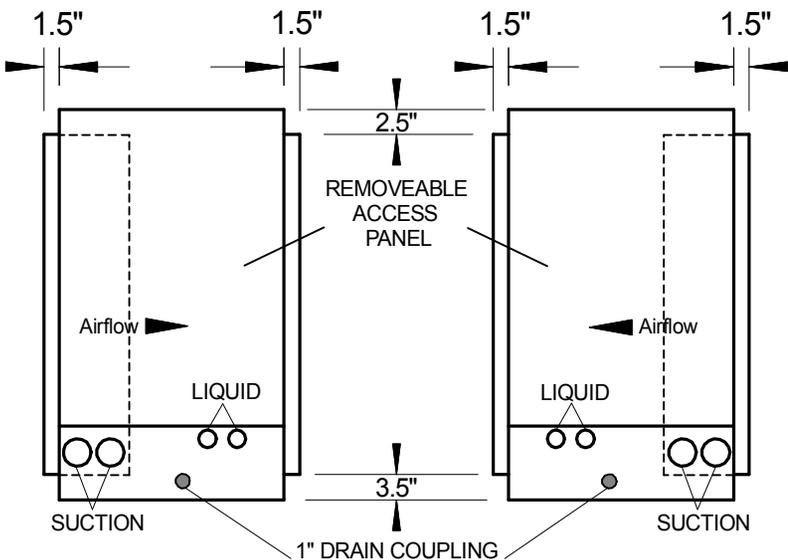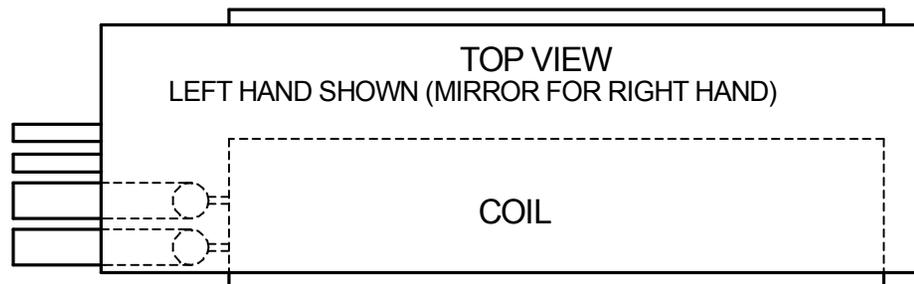

RIGHT HAND COIL LEFT HAND COIL

SIDE ELEVATION VIEW

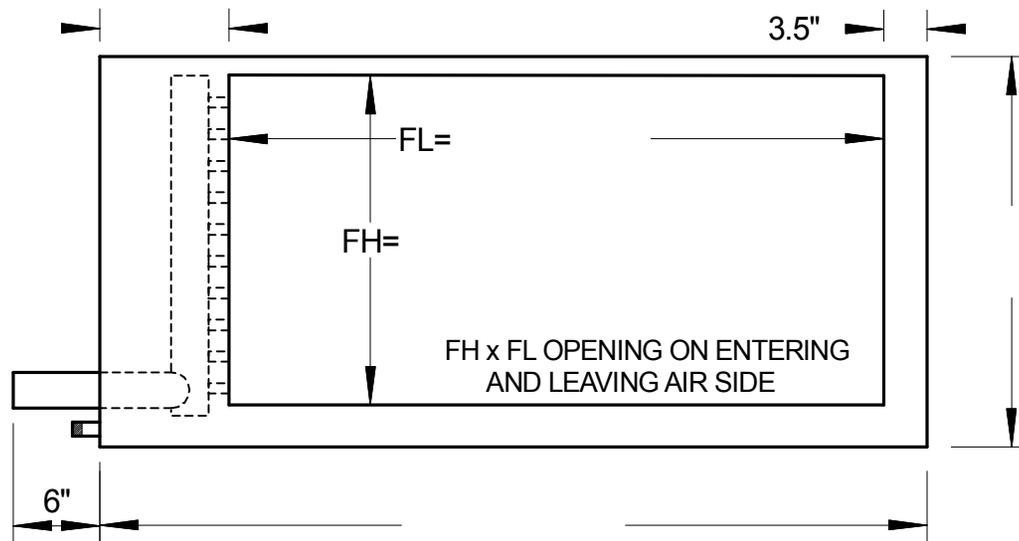

ENTERING / LEAVING AIR SIDE ELEVATION VIEW

TUBES _____ ROWS _____ REFRIG TYPE / TEMP _____

FIN TYPE _____ FINS/INCH _____

CIRCUITING _____ CIRCUIT LOADING (TONS) _____

TXV'S: YES NO # OF HGBP TEES? _____

- 1 CKT 2 CKT 3 CKT 4 CKT
- INTW INTW FACE SPLIT, INTW
- FACE SPLIT FACE SPLIT OTHER

| | |
|---------|--------|
| SUCTION | LIQUID |
| | |

SFI-CAB-DX-2

Date: _____

DIRECT EXPANSION CASED COIL

TAG: _____



PH (800) 430-2536

FAX (800) 718-3738

www.SFICOILS.com

CONSTRUCTION:

1) CASING: 16 GA, GALV.; 1" THICK, 1.5# SF INSULATION

INDOOR STD OUTDOOR WEATHERPROOFED

SINGLE WALL DOUBLE WALL


2) DRAIN PAN; 1" COUPLING DRAIN CONNECTION

16 GA, GALV. 16 GA, STAINLESS

3) SPECIAL ITEMS


- _____
- _____
- _____

- FOR APPROVAL
- FOR RECORD

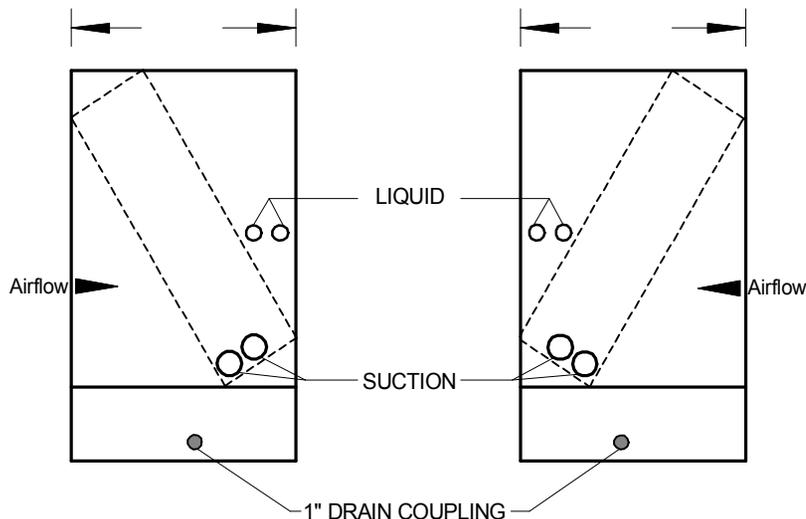

RIGHT HAND COIL LEFT HAND COIL

SIDE ELEVATION VIEW

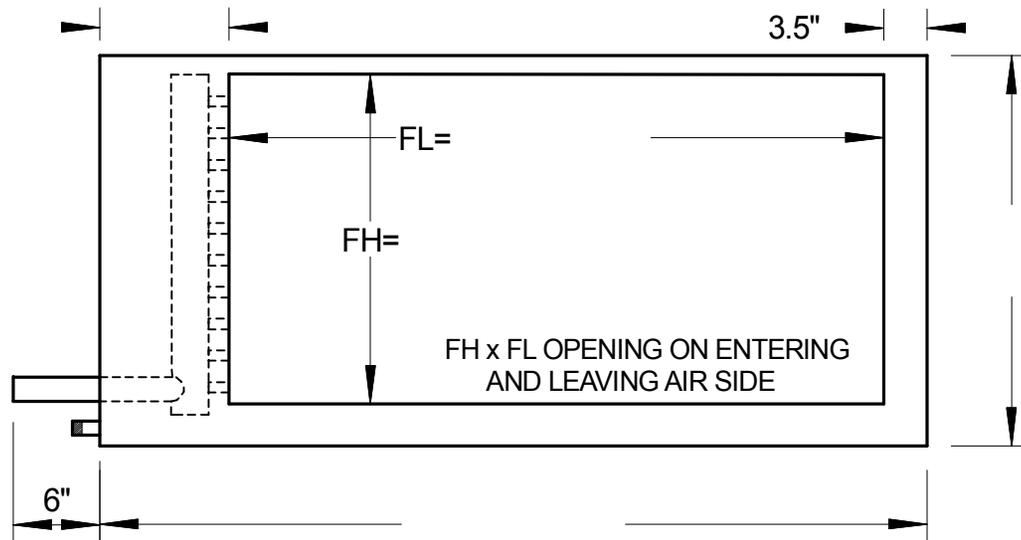

ENTERING / LEAVING AIR SIDE ELEVATION VIEW

TUBES _____ ROWS _____ REFRIG TYPE / TEMP _____
 FIN TYPE _____ FINS/INCH _____
 CIRCUITING _____ CIRCUIT LOADING (TONS) _____
 TXV'S: YES NO # OF HGBP TEES? _____

- 1 CKT 2 CKT 3 CKT 4 CKT
- INTW INTW FACE SPLIT, INTW
- FACE SPLIT FACE SPLIT OTHER

| | |
|---------|--------|
| SUCTION | LIQUID |
| | |

SFI-CAB-CW-1

Date: _____

CHILLED WATER CASED COIL

TAG: _____



PH (800) 430-2536



FAX (800) 718-3738

www.SFICOILS.com

CONSTRUCTION:

- 1) CASING: 16 GA, GALV.; 1" THICK, 1.5# SF INSULATION
 - INDOOR STD OUTDOOR WEATHERPROOFED
 - SINGLE WALL DOUBLE WALL
- 2) DRAIN PAN; 1" COUPLING DRAIN CONNECTION
 - 16 GA, GALV. 16 GA, STAINLESS
- 3) SPECIAL ITEMS
 - _____
 - _____
 - _____

- FOR APPROVAL
- FOR RECORD

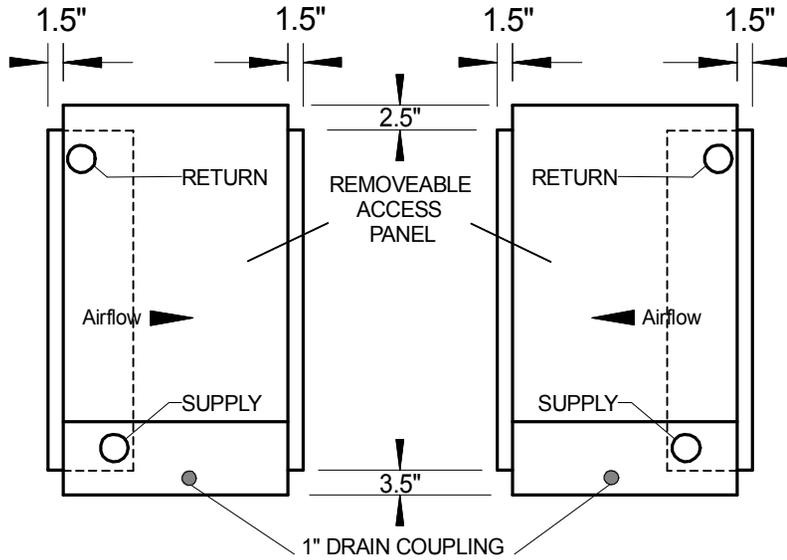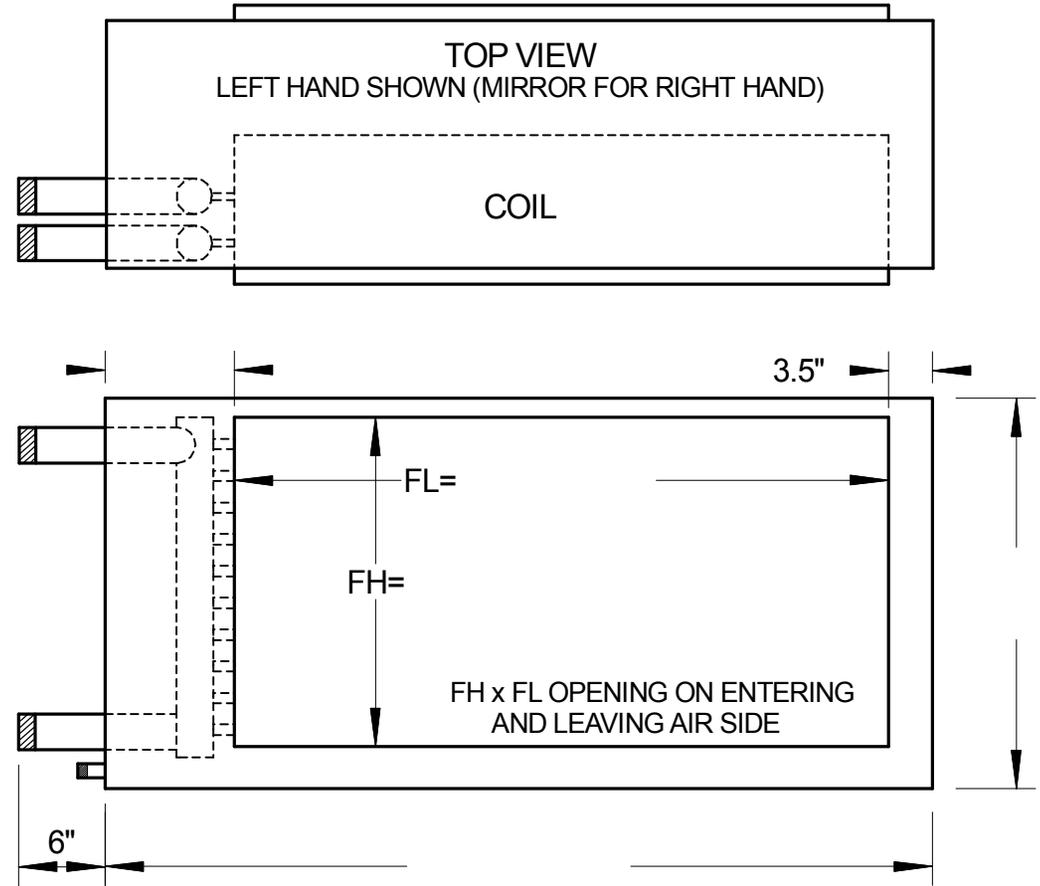

- RIGHT HAND COIL LEFT HAND COIL

SIDE ELEVATION VIEW

ENTERING / LEAVING AIR SIDE ELEVATION VIEW

TUBES _____ ROWS _____
 FIN TYPE _____ FINS/INCH _____
 CIRCUITING _____

CONNECTIONS

- COPPER STEEL OTHER
- MPT MPT SPECIFY
- FPT PLAIN END _____
- ODS

SUPPLY SIZE: _____ RETURN SIZE: _____

NOTES:

| |
|--|
| |
| |
| |
| |